




1 Connect the 24V power source and the computer to configure

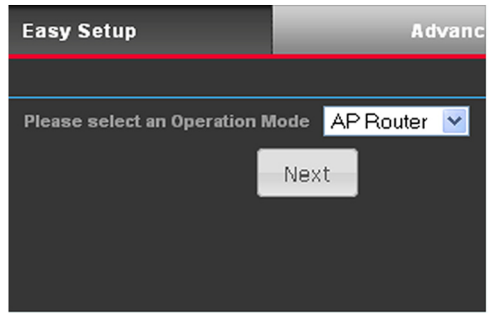


2 Select „AP-Router“ on menu „Easy Setup“

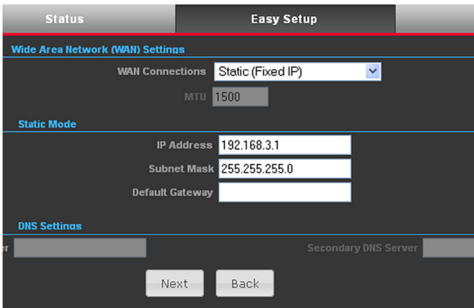

3 Configure your IP address and subnet mask

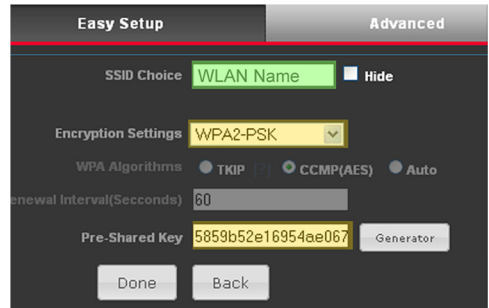

4 Now configure your networkname and encryption
Our recommended encryption is WPA2

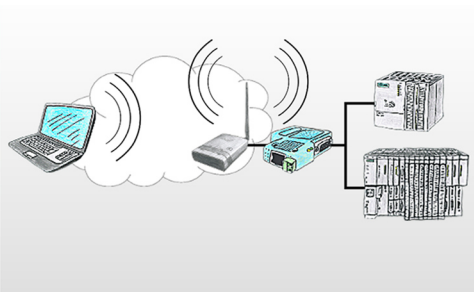


5 Connect the S7-LAN with a patch cable
Your S7-LAN is now available from every WLAN participants




6 Installing TIC driver
TIC driver available on www.tpa-partner.de


Integrate a S7-LAN in a available WLAN with an ALF

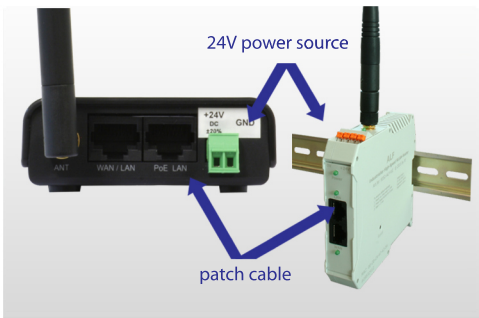


1 Connect the 24V power source and the computer to configure

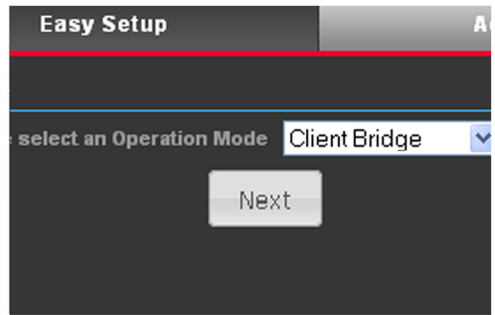

2 Select „Client Bridge“ on menu „Easy Setup“

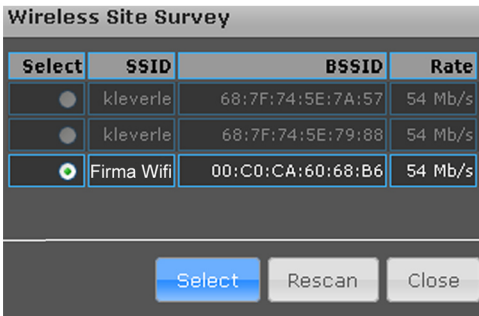

3 Press „Site Survey“ to search every WLAN and select your WLAN

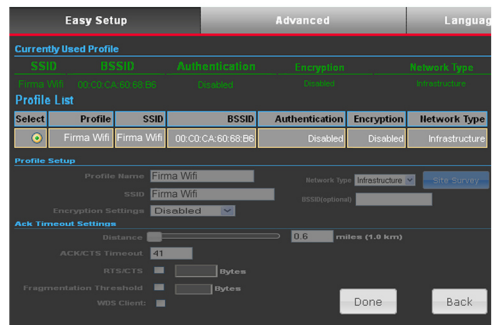

4 Select your WLAN and enter your password. Press „Done“ to confirm




5 Connect the S7-LAN with a patch cable
Every network has to be in the same IP area
Your Module is now integrated




6 Installing TIC driver
TIC driver available on www.tpa-partner.de


Integrate a S5-LAN++ in a available WLAN with an ALF

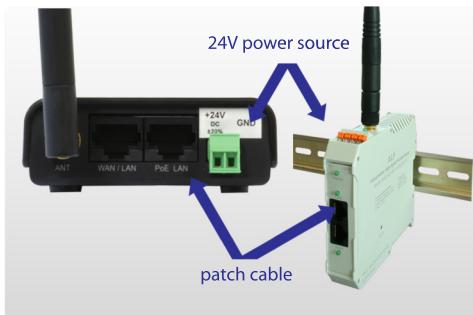


- 1 Connect the 24V power source and the computer to configure

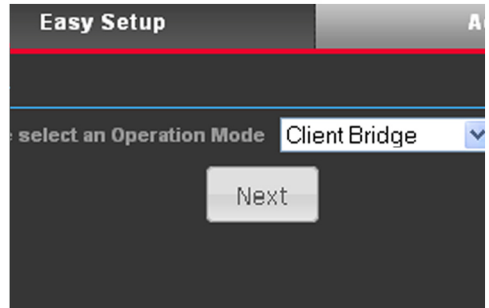


- 2 Select „Client Bridge“ on menu „Easy Setup“

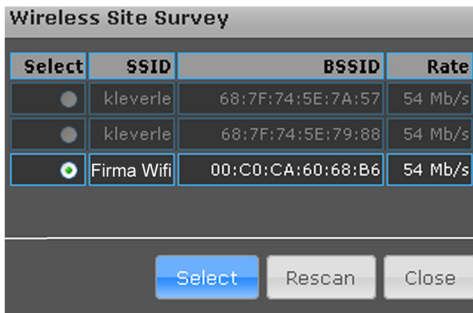

- 3 Press „Site Survey“ to search every WLAN and select your WLAN

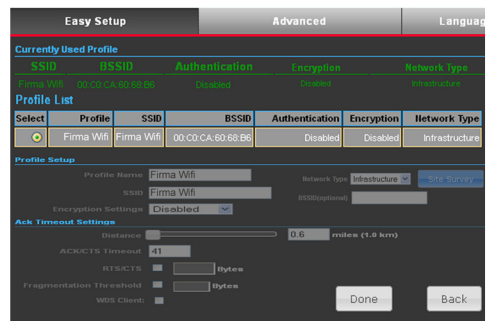

- 4 Select your WLAN and enter your password. Press „Done“ to confirm

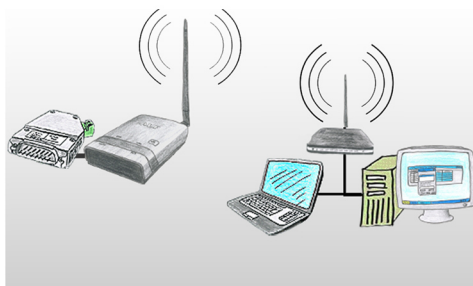


- 5 Connect the S5-LAN++ with a patch cable
Every network has to be in the same IP area
Your Module is now integrated




- 6 Installation:
- S5-Patch for original Step5
- PLCVCOM (virtual COM-Port)
Tools available on www.tpa-partner.de


Using S5-LAN++ with an ALF as a WLAN Router

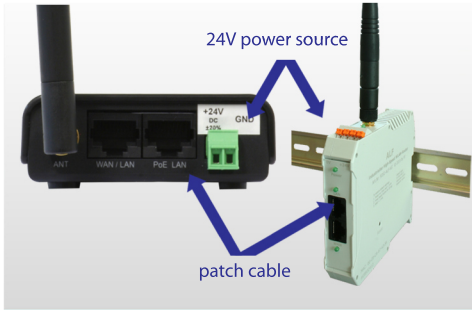


- 1 Connect the 24V power source and the computer to configure

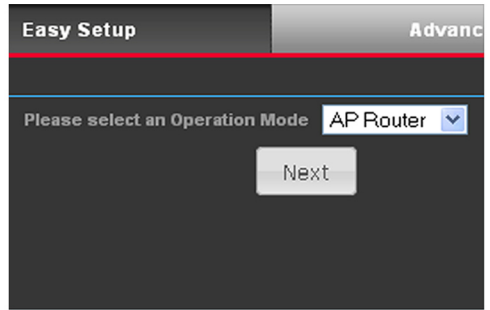

- 2 Select „AP-Router“ on menu „Easy Setup“

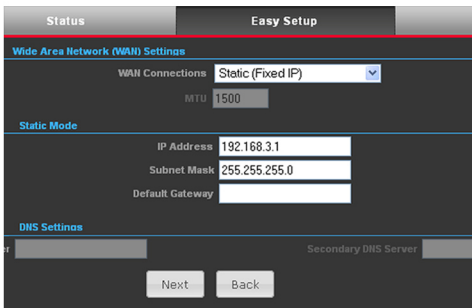

- 3 Configure your IP address and subnet mask

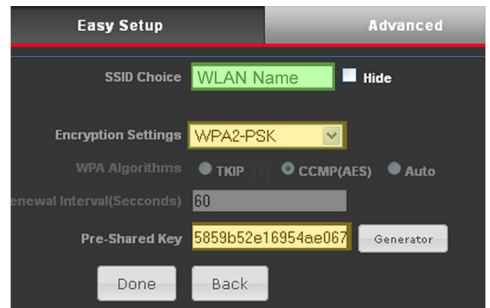

- 4 Now configure your networkname and encryption
Our recommended encryption is WPA2



- 5 Connect the S5-LAN++ with a patch cable
Your S5-LAN++ will get an IP from the DHCP server and is now available from every WLAN participants



- 6 Installation:
 - S5-Patch for original Step5
 - PLCVCOM (virtual COM-Port)Tools available on www.tpa-partner.de

Under the web-address <https://www.process-informatik.de> are product specific documentations or software-driver/-tools available to download.
If you have questions or suggestions about the product, please don't hesitate to contact us.

Process-Informatik Entwicklungsgesellschaft mbH

Im Gewerbegebiet 1

DE-73116 Wäschenbeuren

+49 (0) 7172-92666-0

info@process-informatik.de

<https://www.process-informatik.de>

Copyright by PI - 2026

Menutree Website:


- + Products / docu / downloads
- + Hardware
 - + Programming devices
 - + Programming adapter S7
 - + WLAN/WIFI
 - + Profinet PLCs / Ethernet-CPs
 - + ALF-Devices
 - + ALF

QR-Code Website:




Please make sure to update your drivers before using our products.

Data backup S7-PLC over MPI/Profibus on FTP-server



S7-PLC triggered DB-backup/-restore without additional PC via MPI/Profibus on FTP-server

Router - Mode (access to the network without router)

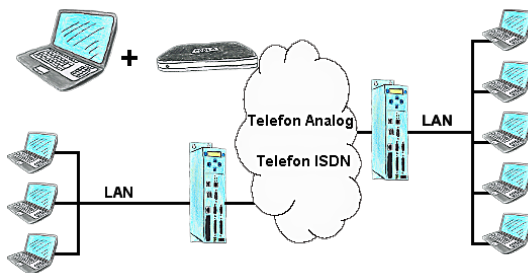

The Tele-Prof-II can also be used as a router for access from a PC via dial-up connection, so that a communication with the behind covered network results. Furthermore a network connection can be made with the TP-II TP-II-line, but in doing so the IP-address-root must differ.

Detect and alarm Profinet burglary




Detection and logging of unauthorized access in the defined Profinet

Attempted break-ins and access to the network are recognized immediately and e.g. reported by email

Logging of all accesses in the network for historical processing

Possible data-storage USB-stick or FTP-server via USB-network-stick.

Operation via web-browser

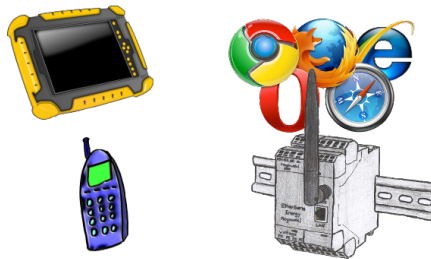

To parameterize the EtherSens-device you dont need a special PC or laptop with special software. Just open with your internet-browser the web-page of the device.